



City of Foley, AL

407 E. Laurel Avenue
Foley, AL 36535

Signature Copy

Ordinance: 18-2004-ORD

File Number: 18-0063

Enactment Number: 18-2004-ORD

An Ordinance to amend Ordinance 17-2037 Building Code & Fee Amendments

WHEREAS, Council adopted Ordinance 17-2037 Building Code & Fee Amendments during the regular scheduled Council meeting of September 5, 2017, and

WHEREAS, the section regarding the Residential Design Criteria and Section 4. Residential Construction Fees need to be amended to reflect the changes as attached and made a permanent part of this ordinance.

NOW, THEREFORE, BE IT ORDAINED BY THE City COUNCIL OF FOLEY, ALABAMA, AS FOLLOWS:

SECTION 1. Amends Ordinance 17-2037 Building Code & Fee Amendments to reflect the changes as attached and made a permanent part of this ordinance.

SECTION 2. This Ordinance shall become effective immediately upon its adoption as required by law.

PASSED, APPROVED AND ADOPTED this 5th day of March, 2018.



President's Signature *[Handwritten Signature]*

Date 3-7-18

Attest by City Clerk *Kathryn Taylor*

Date 3-7-18

Mayor's Signature *[Handwritten Signature]*

Date 3/8/18

I certify that the foregoing Ordinance was published in the Onlooker, a newspaper of general circulation in the City of Foley, in its issue of Wednesday, March 14, 2018."



City of Foley, AL

Signature Copy

Ordinance: 17-2037-ORD

BALDWIN COUNTY, ALABAMA
TIM RUSSELL PROBATE JUDGE
Filed/cert. 9/14/2017 1:39 PM
TOTAL \$ 82.00
24 Pages

1655741




File Number: 17-0439

Enactment Number: 17-2037-ORD

Building Code & Fee Amendments

PASSED, APPROVED AND ADOPTED this 5th day of September, 2017.

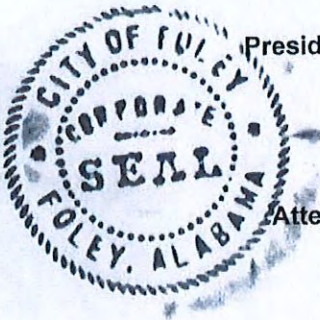

President's Signature

[Handwritten Signature]

Date

9-6-17

Attest by City Clerk

[Handwritten Signature]

Date

9-6-17

Mayor's Signature

[Handwritten Signature]

Date

9/6/2017

I certify that the foregoing Ordinance was published in the Onlooker, a newspaper of general circulation in the City of Foley, in its issue of Wednesday, September 13, 2017."

[Handwritten Signature]
Kathryn Taylor, CMC
City Clerk

ORDINANCE NO. 17-2037

AN ORDINANCE ADOPTING THE 2015 INTERNATIONAL BUILDING (ICC) CODES AND SUPPLEMENTAL PROVISIONS TO UPGRADE THE VARIOUS CODES RELATING TO THE INSPECTION ACTIVITIES OF THE CITY OF FOLEY AND ENFORCEMENT OF THE BUILDING PROVISIONS AND FIRE SAFETY AS PROVIDED IN SAID CODES

BE IT ORDAINED by the Mayor and Council of the City of Foley, Alabama at its meeting on the 5th day of September, 2017 as follows:

SECTION 1 that the following codes or portions of codes be, and the same are hereby, approved and adopted by reference, except for the changes and exclusions listed (if any):

- (a) International Building Code, 2015 Edition, together with Appendix C (Group U – Agricultural Buildings) and Appendix I (Patio Covers); provided, however, the following sections and chapters are omitted and not adopted:
Section 101.4.1 - Gas (International Fuel Gas Code)
Section 105.1.1 - Annual permit
Section 105.1.2 - Annual permit records

The International Building Code, adopted herein shall be amended as follows:

- Section 101.1: (Insert) City of Foley, Alabama
Section 1612.3: (Insert) Baldwin County, Alabama and Incorporated Areas
Section 1612.3: (Insert) July 17, 2007
Section 1613: DELETE IN ITS ENTIRETY

Section 105.5: Expiration. Every permit issued shall become invalid unless the work on the site authorized by such permit is commenced within 180 days after its issuance, or if the work authorized on the site by such permit is suspended or abandoned for a period of 180 days after the time the work is commenced, unless such shorter duration or different expiration terms are imposed on the permit due to special circumstances, such as nuisance abatement projects. The building official is authorized to grant, in writing, one or more extensions of time, for periods not more than 180 days each. The extension shall be requested in writing and justifiable cause demonstrated.

Section 109.3: (Insert) *“For new construction the valuation used to determine the applicable fee shall be calculated from the most current version of the Building Valuation Data published by the International Code Council, bona fide, signed contracts, local averages based on the square footage of the project, or any other evidence of the cost or value of the work.”*

Section 111.5 - Certificate of Completion. Upon satisfactory completion of a building, electrical, mechanical or plumbing permit, a certificate of completion may be issued. This certificate indicates a structure or system is complete and for certain types of permits is released for use and may be connected to a utility system. This certificate does not grant authority to occupy or connect a building, such as a shell building, prior to the issuance of a certificate of occupancy.

COMMERCIAL DESIGN CRITERIA:

Section 1609.3 (Insert) *The ultimate design wind speed, V_{ult} shall be determined as follows:*

RISK CATEGORY 1	RISK CATEGORY 2	RISK CATEGORY 3	RISK CATEGORY 4
147 MPH	157 MPH	170 MPH	***
*** Provide design wind speed determination by calculation			

Chapter 31 – Special Construction

MEMBRANE STRUCTURES:

1. Section 3102 Membrane Structures and Section 3103 Temporary Structures. A permit for a temporary membrane structure on a single commercial premise may be issued for a period not to exceed fourteen (14) consecutive days for a maximum of twelve (12) times per calendar year and must be used on the same lot as the permanent structure *which it serves*. A minimum of two (2) weeks is required between permit issuance periods. The *required* two (2) week period between permits may be waived if the membrane structure is being used along with a permanently occupied business, meeting all ordinances and regulations, and it is for a special event not longer than eight (8) weeks. Any structure outside these parameters will be considered permanent and would be subject to all requirements for permanent structures.

TEMPORARY STRUCTURES:

2. Section 3103 Temporary Structures. A permit for a temporary structure, including mobile vendors, may be issued for a period not to exceed six (6) months during a single calendar year.

(b) International Residential Code, 2015 Edition, together with Exhibit A (Coastal Construction Supplement) attached hereto, Appendix H (Patio Covers), Appendix J (Existing Buildings and Structures), *Appendix M (Home Day Care-R3 Occupancy)*; provided, however, the following sections and chapters are omitted and not adopted:

Section R313 – Automatic Fire Sprinkler Systems

Section: N1102.2.10 Slab-on-grade floors.

Section: N1103.1.1 Programmable Thermostats.

The Residential Code adopted herein shall be amended as follows:

Section R101.1: (Insert) City of Foley, Alabama.

Section R105.2 – Work Exempt from Permit – Building #7 “Prefabricated swimming pools that are 42 inches or less in depth.

RESIDENTIAL DESIGN CRITERIA:

Table R301.2 (1) – Climatic and Geographic Design Criteria – shall be amended as follows:

Table R301.2(1)
CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

GROUND SNOW LOAD	WIND DESIGN		SEISMIC DESIGN CATEGORY	SUBJECT TO DAMAGE FROM			WINTER DESIGN TEMPERATURE	ICE BARRIER UNDERLAYMENT REQUIRED	FLOOD HAZARDS	AIR FREEZING INDEX	MEAN ANNUAL TEMPERATURE
	Speed (mph)	Topographic effects		Weathering	Frost Line Depth	Termite					
0	150	NO	A	Negligible	4"	Very Heavy	30	NO	10/7/2008	32	66.7

Section R314.3 Location. Smoke alarms shall be installed in the following locations:

1. In each sleeping room.

2. Outside each separate sleeping area in the immediate vicinity of the bedrooms, within 21 ft. of any door to a sleeping room, with the distance measured along a path of travel.
3. On each additional *story* of the *dwelling*, including *basements* and habitable attics but not including crawl spaces and uninhabitable *attics*. In *dwellings* or *dwelling units* with split levels and without an intervening door between the adjacent levels, a smoke alarm installed on the upper level shall suffice for the adjacent lower level provided that the lower level is less than one full *story* below the upper level.
4. In the living area(s).

RESIDENTIAL ENERGY CONSERVATION:

Section N1101.4 Above code programs. Above code programs shall be permitted upon approval by the Alabama Residential and Energy Codes Board.

RESIDENTIAL PLUMBING:

Section P2603.5.1 – Sewer Depth. Building sewers that connect to private sewage disposal systems shall be *not less than* eighteen (18) inches below finished grade at the point of septic tank connection. Building sewers shall be *not less than* six (6) inches below grade.

Add Section P3005.2.10.3 – Building Drain and Building Sewer Junction. Sewage line clean-outs shall be permanently protected from damage at ground level by a method approved by the building official.

COMMERCIAL PLUMBING:

- (c) International Plumbing Code, 2015 Edition provided, however, the following sections are amended to read as follows and/or added to said code:

Section 101.1 (Insert) City of Foley, Alabama

Section 305.4.1 – Sewer Depth. Building sewers that connect to private sewage disposal systems shall be a minimum of eighteen (18) inches below finished grade at the point of septic tank connection. Building sewers shall be a minimum of six (6) inches below grade.

Section 708.1.2.1 – Building Sewers. Sewage line clean-outs shall be permanently protected from damage at ground level by a method approved by the building official.

Section 903.1 - Roof Extension. All open vent pipes that extend through a roof shall be terminated at least six (6) inches above the roof, except that where a roof is to be used for any purpose other than weather protection, the vent extensions shall be run at least 7 feet (2134 mm) above the roof.

COMMERCIAL MECHANICAL SYSTEMS:

- (d) International Mechanical Code, 2015 Edition; provided, however, that the following sections are amended to read as follows and/or added to said code:

Section 101.1: (insert) City of Foley, Alabama

Section 606.4.2 – Alarm activation from the installed protective signaling system shall cause shutdown of all HVAC units in the zone, floor or area. If the signaling system is unable to designate a specific zone, floor or area, global shutdown of all HVAC systems in the building shall occur upon fire alarm activation.

FIRE CODES:

- (e) International Fire Code, 2015 Edition; and Appendices A, B, C, D, F, H and I; provided, however, the following sections are amended to read as follows and/or added to said code:

Section 101.1: (Insert) City of Foley, Alabama

Section 109.4 (SPECIFY OFFENSE) Fire Code Violation

(AMOUNT) As Determined by the Municipal Court System

(NUMBER OF DAYS) As Determined by the Municipal Court System

Section 111.4: Failure to comply. Any person who shall continue any work after having been served with a stop work order, except such work as that person is directed to perform to remove a violation or unsafe condition, shall be liable and subject to penalties as determined by the Municipal Court System.

Section 302.1 Definitions – Definitions.

RECREATIONAL FIRE. An outdoor fire for pleasure, religious, ceremonial, cooking, warmth or similar purposes, burning material other than rubbish.

PORTABLE/FIXED OUTDOOR FIREPLACE. A portable or fixed, outdoor, solid-fuel-burning fireplace that may be constructed of steel, concrete, clay or other noncombustible material. A portable or fixed outdoor fireplace may be open in design, or may be equipped with a small hearth opening and a short chimney or chimney opening in the top.

Section 307 – Open Burning.

Recreational Fire and Portable/Fixed Outdoor Fireplaces shall be amended as follows:

Section 307.1.1.1. No person shall kindle or maintain any open fire or authorize any such fire to be kindled or maintained without first obtaining a permit or other proper authorization. During the construction or demolition of any structure, no waste materials or rubbish shall be disposed of by burning on the premises or in the immediate vicinity without having obtained a permit or other proper authorization.

Exception: A permit is not required for approved recreational or fires in portable/fixed outdoor fireplaces or approved containers.

Section 307.1.1.2. Only untreated wood and plant growth shall be permitted to be burned. Under no circumstances shall any treated or painted lumber, heavy oils, items containing synthetic or natural rubber, asphaltic materials, plastics, or refuse be burned.

Section 307.1.1.3. Open fires permitted in this section shall not commence before 6:00 a.m. and no combustible material shall be added to the fire after 3:00 p.m. of each day permitted. The fire official may prohibit any or all open burning when local circumstances or atmospheric conditions make such fires hazardous.

Section 307.1.1.4. Open burning of materials generated by major land clearing practices is prohibited in the corporate City limits of Foley.

Exception: The disposal of plant growth generated by major land clearing practices may be conducted only in an incinerator approved by the fire code official.

Section 307.4 – Location. The location for open burning shall not be less than five hundred feet (500') from any structure, other than a structure located on the property on which the burning is conducted. Adequate provision shall be made to prevent the fire from spreading; and the location is not less than five hundred feet (500') from any public road, street or highway and is controlled so as not to create a hazard to health or traffic as a result of the smoke emitted.

Exceptions: Fires in approved areas or containers that are not less than fifteen feet (15') from a structure.

Section 307.4.3 Portable/Fixed Outdoor Fireplaces. Portable and/or fixed outdoor fireplaces shall be used in accordance with the manufacturer's instructions and shall not be operated within 15 feet (3048 mm) of a structure or combustible material.

Section 307.6. The requirements established in this section shall not prohibit the Fire Official from making exception to these requirements from time to time for purposes relating to the common good of the community.

Section 308.1.4 – Open-flame cooking devices. Charcoal burners and other open-flame cooking devices shall not be operated on combustible balconies or within 10 ft. (3048 mm) of combustible construction.

Propane cooking devices shall not be stored on combustible balconies.

Exceptions: 1. One and two family dwellings.

Section 311.2.2 – Fire Protection. Fire alarm, sprinkler and standpipe systems shall be maintained in an operable condition at all times. Any impairment to or malfunction of the fire alarm, sprinkler or standpipe system shall be reported to the fire department.

Exceptions:

1. When the premises have been cleared of all combustible materials and debris and, in the opinion of the fire code official, the type of construction, fire separation distance and security of the premises do not create a fire hazard.

2. Where *approved* by the fire chief, buildings that will not be heated and where fire protection systems will be exposed to freezing temperatures, fire alarm and sprinkler systems are permitted to be placed out of service and standpipes are permitted to be maintained as dry systems (without an automatic water supply), provided the building has no contents or storage, and windows, doors and other openings are secured to prohibit entry by unauthorized *persons*.

Section 503.2.2 - Authority. The fire code official shall have the authority to require an increase in the minimum access widths and vertical clearances where they are inadequate for fire or rescue operations.

Section 503.3 - Marking. Where required by the fire code official, approved signs or other approved notices or markings shall be provided for fire apparatus roads to identify such roads or prohibit the obstruction thereof. The means by which fire lanes are designated shall be maintained in a clean and legible condition at all times and be replaced or repaired when necessary to provide adequate visibility. Fire lane striping shall consist of six-inch (6") wide red background stripe with four-inch (4") high white lettering stating "NO PARKING FIRE LANE" at intervals not to exceed 25 feet. Fire lane marking shall be on the vertical surface of the curb unless otherwise approved by the fire code official.

Section 901.2.1.1 – All sprinkler and fire alarm design drawings submitted to the fire department for review shall abide by the Alabama State Board of Licensure for Professional Engineers and Land Surveyors' fire protection position statement. NICET certification does not replace the requirement for professional licensure. The designing of fire protection and detection systems is engineering and as such must be designed by or under the direct supervision of professional engineers qualified to design fire protection and detection systems. Only fire protection and detection designs that have been signed and sealed by a qualified Alabama licensed professional engineer shall be approved for construction.

Section 901.2.1.2 – Contractor Qualification Requirements. Copies shall be submitted to the Code Official for review.

Restaurant Fire Suppressions Systems:

- The qualifier must be either manufacturer certified, which restricts them to that manufacturer, and/or NAFED/ICC certified in that field which would allow them to be unrestricted and service or maintain any system (This will not cover installation; maintenance only).

Hood Cleaning:

- Current certificate of training on hood cleaning in compliance with NFPA 96.

Sprinkler Systems:

- Current sprinkler permit through the Alabama State Fire Marshal's Office and NICET certification.

Fire Alarm Systems:

- Current fire alarm permit through the Alabama State Fire Marshal's Office and NICET certification. Must be a minimum of NICET II to perform technician work, or work under the direct supervision of a NICET II.

Fire Extinguishers:

Current certificate of training on portable fire extinguishers in compliance with NFPA 10.

Section 903.2.8 – Group R. An automatic sprinkler system installed in accordance with Section 903.3 shall be provided throughout all buildings with a Group R fire area except in one and two family dwellings in accordance with the State of Alabama Act 2010-185 mandate. However, if automatic sprinkler systems are voluntarily installed in one or two family dwelling they shall be installed as set forth in Section 903.3.

Section 903.3.7 – Fire Department Connections. The location of fire department connections shall be remote of the building, outside of the building's collapse zone, whenever possible. The collapse zone is a distance away from the building equal to the height of the exterior wall on the side of the fire department connection. The location shall be approved by the fire code official.

Section 903.3.7.1 - All above ground piping exposed to the weather shall be insulated to protect from freezing.

PROPERTY MAINTENANCE:

- (f) International Property Maintenance, 2015 Edition; provided, however, that the following sections are amended to read as follows and/or added to said code:

Section 101.1: (insert) City of Foley, Alabama

Section 302.4: (Insert) 12 Inches

- (g) International Existing Building Code, 2015 Edition, together with Appendix A (Referenced standards); provided, however, the following sections are omitted and not adopted:

Section 105.1.1 – Annual permit

Section 105.1.2 – Annual permit records

The International Existing Building Code adopted herein shall be amended as follows:

Section 101.1: (Insert) City of Foley, Alabama

Section 1401.2: (Insert) (The Effective Date of this Ordinance)

COMMERCIAL ENERGY CONSERVATION:

- (h) 2015 International Energy Conservation Code (IECC), as amended by the Code of the State of Alabama, shall be implemented and enforced for new habitable commercial buildings and habitable residential buildings three (3) stories and above including multi-family dwellings provided, however, the following sections and chapters are omitted and not adopted:

Section R402.2.9 10 Slab-on-grade Floors
Section R403.1.1 Programmable Thermostat
Section R403.9 10 Pools and inground permanently installed spas (Mandatory)
Section R403.9 10 .1 Heaters
Section R403.9 10 .2 Time Switches
Section R403.9 10 .3 Covers

The following sections are amended to read as follows and/or added to said code:

Section C101.1 and R101.1: (insert) City of Foley, Alabama

COMMERCIAL ELECTRICAL CODES:

- (i) NFPA 70, National Electric Code, 2014 Edition provided, however, the following sections are amended to read as follows and/or added to said code:

Article 362 – Electric nonmetallic tubing type ENT, shall only be allowed for low voltage AC circuits not exceeding twenty-five (24) volts and data-com.

ELECTRICAL POWER CONNECTIONS:

1. Electrical Power Connections:

- a) Temporary Power Defined – Electric power service, permanently connected to buildings and structures, but limited to use for a specified period of time, and for the express purpose of testing and inspecting electrically powered systems and equipment installations during new construction, or during renovations, alterations, or repairs to existing structures or buildings.
- b) Permanent Power Defined – Electric power service, permanently connected to a building or structure to provide a continuous electric current source to operate electrically powered systems and equipment.
- c) Permanent power and temporary power connections to buildings and structures within the corporate City limits of Foley shall be approved by the Inspection Department.
- d) Temporary electrical power service connections to buildings under construction shall be obtained in the name of the contractor and shall not exceed a time period limitation of thirty (30) calendar days from the date of the connection.
- e) Upon issuance of a permit for major renovations, alterations, or repairs to either the structural elements of a building, or to the electrical system, electric power service shall be converted to a temporary permanent status, and shall be limited to a time period of thirty (30) calendar days from the date of the issuance.
- f) Permanent electric power service connections to such buildings and structures as are outlined in b) above shall be approved only upon completion of all permitted work, and the issuance of the Certificate of Occupancy or Completion.

2. All non-residential electrical work requires a properly licensed electrician.

MANUFACTURED HOMES:

- (j) NFPA 501A, Manufactured Home Installations, Sites, and Communities, 2017 Edition.

RECREATIONAL VEHICLE PARKS:

- (i) NFPA 1194, Recreational Vehicle Parks, 2014 Edition.

WATER SUPPLY, SUBURBAN AND RURAL FIRE FIGHTING:

- (j) NFPA 1142, Water Supplies, Suburban and Rural Fire Fighting, 2012 Edition.

AMERICANS WITH DISABILITIES ACT:

- (m) Accessible and Usable Building and Facilities, ICC/ANSI A117.1, 2009 Edition.

FIRE ALARMS:

- (n) NFPA 72: National Fire Alarm and Signaling Code, 2013 Edition.

WET CHEMICAL EXTINGUISHING:

- (o) NFPA 17A: Standard for Wet Chemical Extinguishing Systems, 2013 Edition

RESIDENTIAL SPRINKLER SYSTEMS:

- (p) NFPA 13R: Standard for the Installation of Sprinkler Systems in Residential Occupancies up to and including Four Stories in Height, 2013 Edition.

- (q) NFPA 13D: Standard for the Installation of Sprinkler Systems in One- and Two-Family Dwellings and Manufactured homes, 2013 Edition.

COMMERCIAL SPRINKLER SYSTEMS:

- (r) NFPA 13: Standard for the Installation of Sprinkler Systems, 2013 Edition.

PORTABLE FIRE EXTINGUISHERS:

- (s) NFPA 10: Standard for Portable Fire Extinguishers, 2013 Edition.

STANDPIPES AND HOSE SYSTEMS:

- (t) NFPA 14: Standard for Installation of Standpipes and Hose Systems, 2013 Edition.

SECTION 2 That the following laws are hereby ratified, passed or adopted:

SUBMITTAL DOCUMENTS:

1. Submittal documents required to be prepared by a design professional:
 - (a) Any new habitable structure.
 - (b) Any residential addition over one thousand (1,000) square feet in area or that creates more than a fifty (50%) percent improvement to the structure.
 - (c) Any residential remodel that affects the exterior loads or is considered a fifty (50%) percent improvement to the structure.
 - (d) Any commercial addition that is over one thousand (1,000) square feet in area, increases the original structure to over twenty-five hundred (2,500) square feet in area or affects the loads, energy values or life safety plan of the original structure.
 - (e) Any commercial remodel to a structure that is over twenty-five hundred (2,500) square feet in area or changes the structural load, energy values or life safety plan of the original structure.
 - (f) Any built-on-site accessory structure over one thousand (1,000) square feet in area.
 - (g) Any pre-built accessory, modular or manufactured structure.
 - (h) Any free-standing sign with a face over thirty-two (32) square feet in area or more than nine (9) feet in height at the highest point.
 - (i) Any engineered product, such as a truss system.
 - (j) Any geotechnical data.
 - (k) Any project requiring a design professional as determined by the state architectural or engineering boards.

The information required includes structural loads, energy values and/or commercial electrical, mechanical, plumbing or life safety plans.

*EXCEPTIONS: Non-habitable structures or signage will not have to provide energy values.

Digital copies (PDF) of plans/revisions shall be submitted along with the hard copies

ATTIC STAIRWAYS:

2. Permanent Attic Stairways: In addition to other types of attic stairways permitted under this code, permanent stairs leading to a non-habitable attic space may also be allowed, but only if they meet or exceed the following criteria and only if the Owner and Contractor sign an acceptable hold harmless and indemnity agreement in favor of the City of Foley and its agents:

- (a) Permanent attic stairs must have a minimum net clearance between the inside edge of the handrail or, if none, the fire rated interior finished wall on one side and the inside edge of the handrail or fire rated interior finished wall on the other side of at least twenty-four inches (24").
- (b) Treads and Risers: Permanent attic stairs shall have a riser height of no greater than nine inches (9") and shall have a tread depth of no less than five and one-half inches (5½"). All risers shall be "open" between the steps.
- (c) Illumination: Attic stairs must be illuminated, and shall have a light switch at the bottom of the stairs and a light at the top of the stairs.
- (d) Under Stair Protection: Attic staircases must be enclosed on both sides with fire rated interior finished wall for fire protection, and must have a lockable, metal door blocking the entrance to the bottom of the staircase which can be opened without a key from inside the stairwell.
- (e) Hand Rails: Permanent attic staircases must have at least one handrail running along the entire length of the staircase.
- (f) Any provisions contained in the 2015 International Residential Code which directly conflict with these provisions is hereby repealed or deleted, but only to the minimum extent required to make these changes effective.

PERMIT EXCEPTIONS:

- 3. Permit exceptions: Construction and construction-related activities which are being performed by or on behalf of the federal government, the State of Alabama, Baldwin County, or any departments, agencies, boards, divisions, or subdivisions of the same for their own use shall be exempt and excluded from the permits, permit fees, inspections, and inspection fees called for in this Article. The City of Foley shall be exempt and excluded from the permit fees and inspection fees. Subject to the forgoing, all construction and construction-related activities must conform to all applicable federal, state, county and local laws relating to the same, and it is the responsibility of the federal government, the State of Alabama, Baldwin County, the City of Foley, or the department, agency, board, division, or subdivision on whose behalf the work is being performed to ensure compliance with all applicable laws and ordinances. This section shall not exclude construction or construction-related activities which are merely funded, in whole or in part, by federal, state, county or municipal monies but which will not be owned or occupied by that governmental entity after the completion of the construction or construction-related activities.

PERMIT FEES:

- 4. Permits and Fees.

Section 1. Permit Fees shall read as follows: "Each person, firm, corporation or other entity engaged in any construction or construction-related activity for which a City building permit is required shall, before the commencement of work, pay the appropriate building permit fee. For the purpose of determining the fee for the issuance of a building permit, the value of the requested work is determined by the City of Foley Inspection Department which may consider the most current version of the Building Valuation Data published by the International Code Council, bona fide, signed contracts, local averages based on the square

footage of the project (currently the minimum valuation for new residential one and two family construction will be figured at \$80 per square foot for conditioned space and \$40 per square foot for unconditioned space), or any other evidence of the cost or value of the work. The following fees shall be charged for the issuance of building permits based on the total value of work, including materials and labor.”

Section 2. Fees based off of valuation shall be determined by using the following method:

<u>Value</u>	<u>Fee</u>
Minimum	\$50.00
Up to \$1,000	\$50.00
\$1,001 to \$50,000	\$50.00 for the first \$1,000 + \$10.00 for each additional \$1,000 or fraction thereof
\$50,001 to \$100,000	\$540.00 for the first \$50,000 + \$8.00 for each additional \$1,000 or fraction thereof
\$100,001 to \$500,000	\$940.00 for the first \$100,000 + \$6.00 for each additional \$1,000 or fraction thereof
\$500,001 and up	\$3,340.00 for the first \$500,000 + \$4.00 for each additional \$1,000 or fraction thereof

Section 3: “When commercial and residential building plans are submitted for review under the International Building Code and the International Residential Code, a plan review fee shall be paid to the Building Department at the time of submitting the plans and specifications for review.

Section 4. Residential Construction Fees:

New Construction:

- a) Plan Review (Flat Fee): Single Family/Duplex - \$50 per unit, Multi-family – Same as Commercial
- b) Building Permit (Valuation) – See Valuation Fee Method
- c) Electrical Permit (Flat Fee) - \$175 per unit
- d) Plumbing Permit (Flat Fee) - \$100 per unit
- e) Mechanical Permit (Flat Fee) - \$75 per unit

Miscellaneous Residential Fees:

- a) Remodeling/Addition Building Permit (Valuation) See Valuation Fee Method
- b) Remodeling/Addition Electrical Permit (Fixture Count) See Fixture Count Method
- c) Remodeling/Addition Plumbing Permit (Fixture Count) See Fixture Count Method
- d) Remodeling/Addition Mechanical Permit (Flat Fee) - \$75.00 per unit
- e) Swimming Pool/Spa (Valuation) See Valuation Fee Method
- f) Swimming Pool/Spa Electrical (Fixture Count) See Fixture Count Method
- g) Reroofing (Valuation) See Valuation Fee Method
- h) Electrical Service Panel/Meter Replacement Only (Flat Fee) - \$50.00
- i) Sewer Line Installation/Replacement Only (Flat Fee) - \$50.00
- j) HVAC Unit Replacement Only (Flat Fee) - \$75.00
- k) Manufactured Home Installation (Flat Fee) - \$50.00
- l) Manufactured Home Installation Electrical (Flat Fee) - \$50.00
- m) Demolition (Flat Fee) - \$50.00 per structure
- n) Contractor Temporary Power Pole Only (Flat Fee) - \$50.00
- o) Fence (Valuation) See Valuation Fee Method
- p) Re-inspection Fee (Flat Fee) - \$25.00 when not prepared for scheduled inspection or for any inspection for the same item after 1st re-inspection
- q) Working Without A Permit Penalty – Permit Fees are doubled plus any additional fees as determined by other City of Foley Departments

Section 5: Commercial Construction Fees:

1. New Construction:
 - a) Plan Review – Fee is equal to one half of the permit fee
 - b) Building Permit (Valuation) – See Valuation Fee Method
 - c) Electrical Permit (Fixture Count) – See Electrical Fixture Count Method
 - d) Plumbing Permit (Fixture Count) – See Plumbing Fixture Count Method
 - e) Mechanical Permit (Valuation) – See Mechanical Valuation Fee Method
2. Miscellaneous Commercial Fees:
 - a) Remodeling/Addition Building Permit (Valuation) See Valuation Fee Method
 - b) Remodeling/Addition Electrical Permit (Fixture Count) See Fixture Count Method
 - c) Remodeling/Addition Plumbing Permit (Fixture Count) See Fixture Count Method
 - d) Remodeling/Addition Mechanical Permit (Flat Fee) - \$75.00 per unit
 - e) Swimming Pool/Spa (Valuation) See Valuation Fee Method
 - f) Swimming Pool/Spa Electrical (Fixture Count) See Fixture Count Method
 - g) Reroofing (Valuation) See Valuation Fee Method
 - h) Electrical Service Panel/Meter Replacement Only (Flat Fee) - \$50.00
 - i) Sewer Line Installation/Replacement Only (Flat Fee) - \$50.00
 - j) HVAC Unit Replacement Only (Valuation) – See Mechanical Valuation Fee Method
 - k) Manufactured/Modular Office Installation (Valuation) – See Valuation Fee Method
 - l) Manufactured/Modular Office Installation Electrical (Flat Fee) - \$50.00
 - m) Demolition (Flat Fee) - \$100.00 per structure
 - n) New Tenant Power Change-Out Only (Flat Fee) - \$50.00
 - o) Contractor Temporary Power Pole Only (Flat Fee) - \$50.00
 - p) Fence (Valuation) See Valuation Fee Method
 - q) Manufactured/Modular/Mobile Building - Temporary Commercial Use (Flat Fee) - \$225.00 for 6 month period; can be renewed, with approval for the same fee.
 - r) Manufactured/Modular Building - Temporary Construction Field Office (Flat Fee) - \$50.00 for 6 month period; can be renewed, with approval for the same fee.
 - s) Manufactured/Modular Building - Temporary Watchman's Quarters (Flat Fee) - \$225.00 for 6 month period; can be renewed, with approval for the same fee.
 - t) Tent/Membrane Structure –Temporary Commercial Use (Flat Fee) \$50.00 per period
 - u) Re-inspection Fee (Flat Fee) - \$25.00 when not prepared for scheduled inspection or for any inspection for the same item after 1st re-inspection
 - v) Working Without A Permit Penalty – Permit Fees are doubled plus any additional fees as determined by other City of Foley Departments
 - w) Signs (Valuation) See Valuation Fee Method

Section 6: Mechanical Valuation Fee Method:

Mechanical Fees will be based on the total value or cost of the work to be performed, as determined by the City of Foley Inspections Department, which may consider bona fide signed contracts or any other evidence of the cost or value of the work as follows:

<u>Value</u>	<u>Fee</u>
Minimum	\$50.00
Up to \$1,000	\$50.00
\$1,001 and up	\$50.00 for the first \$1,000 + \$10.00 for each additional \$1,000 or fraction thereof

Section 7. Electrical Fixture Count Method:

Electrical Fees will be based on the nature and extent of the work to be performed based on the following:

(A) Minimum Electric Fee \$50.00

(B) Wiring, outlet and fixture fees are based on wiring to an outlet or fixture, with wall switches to be included in the fixture category as follows:

1) Outlets	
<u>Number of Outlets</u>	<u>Fee</u>
1 to 3	\$2.00
4 to 10	\$2.50
11 to 15	\$3.00
16 to 24	\$4.00
25 to 50	\$6.00
51 to 75	\$8.00
76 to 100	\$12.00
Over 100	\$12.00 + \$.50 for each outlet over 100

2) Fixtures	
<u>Number of Fixtures</u>	<u>Fee</u>
1 to 5	\$3.00
6 to 15	\$5.00
16 to 30	\$7.00
31 to 40	\$9.00
41 to 50	\$11.00
51 to 60	\$13.00
61 to 70	\$15.00
71 to 80	\$17.00
81 to 90	\$19.00
91 to 100	\$20.00
Over 100	\$20.00 plus \$.50 for each fixture over 100

(C) Wiring and installation of U.L. Listed pre-wired equipment not otherwise shown on other schedules:

<u>Number of Circuits</u>	<u>Fee</u>
1 to 3	\$5.00
4 to 6	\$10.00
7 to 10	\$15.00
Over 10	\$15.00 + \$1.00 for each circuit over 10

(D) Main line service for light, heat, or power:

<u>Switch Amperes</u>	<u>Fee</u>
100 Amperes or less	\$6.00
200 Amperes	\$8.00
400 Amperes	\$10.00
600 Amperes	\$14.00
800 Amperes	\$18.00
1200 Amperes	\$22.00
2000 Amperes or more	\$30.00

Fees for switches shall include only mainline service entrance switches and switches for sub-feeder panels.

(E) Wiring for and installation of motors:

<u>Motor HP</u>	<u>Fee</u>
5 HP or less	\$5.00
6 HP to 10 HP	\$6.00
11 HP to 20 HP	\$8.00
21 HP to 30 HP	\$10.00
31 HP to 50 HP	\$14.00
51 HP to 100 HP	\$18.00
Above 100 HP	\$18.00 + \$1.00 per HP above 100

(F) Wiring for and installation of generators and transformers:

<u>Ratings of Units</u>	<u>Fee</u>
10 KW or less	\$5.00
11 KW to 25 KW	\$8.00
26 KW to 50 KW	\$14.00
Above 50 KW	\$20.00

(G) Wiring for and installation of all exterior signs:

<u>Number of Signs</u>	<u>Fee</u>
Any number	\$25.00

(H) Wiring for and installation of heating and appliances, ranges, ovens, cooktops, water heaters, and other appliances not addressed elsewhere herein:

<u>Unit Wattage</u>	<u>Fee</u>
750 Watts or less	\$5.00
Above 750 Watts, up to 3750	\$8.00
Over 3750	\$10.00

Section 8. Plumbing Fixture Count Fee Method

Plumbing fees will be based on the nature and extent of the work to be undertaken based on the following:

(A) Minimum plumbing fee \$50.00

(B) Unit/Fixture fees:

<u>Unit or Fixture</u>	<u>Fee</u>
Water Closets	\$4.00
Bathtubs	\$4.00
Lavatories	\$4.00
Sinks	\$4.00
Urinals	\$4.00
Drinking Fountains	\$4.00
Shower Baths	\$4.00
Bidet	\$4.00
Clothes Washer – Commercial	\$4.00
Clothes Washer – Residential	\$2.00
Floor Drains	\$2.00
Garbage Grinder – Commercial	\$5.00
Garbage Grinder – Residential	\$4.00
Gravity Storage Tank	\$3.00
Hot Water Storage Tank	\$3.00
Indirect Waste Receptors	\$3.00
Oil or Grease Separators	\$2.00
Ornamental Fountain or Pool	\$5.00
Relief Valves – Separate	\$2.00
Sewer Ejectors – Pump	\$7.00
Solids Separators	\$2.00
Sump Pump	\$5.00
Hot Water Heaters – Electric	\$4.00
Hot Water Heaters – Gas	\$4.00
Water Heaters – Alternate	\$11.00
Water Pumps	\$4.00
Water Treatment Devices	\$2.00
Building Sewer – Connection to Main Slab	\$5.00

Sewer Repair	\$4.00
Septic Tank Connection	\$4.00
Building Drains to Sewer	\$2.00
Water – Meter to Building	\$2.00
Water Distribution – 1 st Outlet	\$2.00
Water Distribution – Each Additional	\$1.00
Hose Bibs	\$2.00
Dishwasher	\$4.00
Kitchen Sinks & Disposal	\$4.00
Laundry Tray	\$4.00
Service Sink	\$4.00
Icemaker	\$2.00

Section 9: Miscellaneous Fees

All fees listed below will be payable at the time of permit issuance and shall be duly receipted prior to the commencement of work:

- (1) Moving a Building or Structure:
The permit fee for moving any building is \$100.00.

Section 10: Other Fees:

- (1) Weekend or After Hours Fees:

Fees for after hours or weekend inspections shall be paid prior to such request for an appointment granting the inspection, and shall be in addition to all other fees. Such after hour and weekend fees will be based on a fee of \$40.00 per hour or portion thereof, and in no case shall be less than two hours. Normal business hours of the Building Inspections Department of the City of Foley shall be posted within the office confines of the Department.

- (2) Fees for Additional Work:

In the event that during the performance of the work allowed under the permit, additional installations or alterations are required, it shall be unlawful for the person who secured the original permit to fail to immediately remit to the Building Inspections Department an amount equal to the additional fees called for under this Ordinance.

- (3) Double Fees:

When work for which a permit is required is commenced prior to the obtaining of a permit, the applicant shall be required to pay a permit fee equal to two times the amount the fee would otherwise be. The payment of the double fee shall not relieve any person from fully complying with all of the requirements of all applicable regulations and codes, nor shall it relieve them from being subject to any of the penalties therein, including, but not limited to suspension or termination of the work.

- (4) Unused Permits and Refunds:

The City Clerk of the City of Foley is authorized to refund fees paid for permits issued under this Ordinance at any time within 180 days after the issuance of said permits provided the Building Official certifies to the City of Foley Clerk, and a written request and explanation is received from the applicant, as follows:

- (A) That the permit for which the refund is requested has been cancelled and no work has begun. (Any refund made under this provision shall be subject to an administrative charge of \$50.00 which amount shall be deducted from the amount of refund applied for); or

- (B) That the work for which the permit refund is requested is not going to be completed. (Any refund made under this provision is subject to a prorated refund as determined by the Building Official and an administrative charge of \$50.00 which amounts shall be deducted from the amount of refund applied for.) Notwithstanding the above, no plan review fees will be refunded.

Section 11: Planning and Zoning Fees:

(1) Miscellaneous Fees as follows:

- a) ZONING PLAN REVIEW – The fee for zoning plan reviews shall be TWENTY FIVE DOLLARS (\$25.00) per residential plan and FIFTY DOLLARS (\$50.00) per commercial plan.
- b) There shall be a TWENTY FIVE DOLLAR (\$25.00) fee for a Flood Determination letter, a TWENTY FIVE DOLLAR (\$25.00) fee for a Zoning Verification letter.
- c) Land Disturbance activities as follows: "Application must be accompanied by a fee of Four Hundred Fifty Dollars (\$450.00) for up to five acres plus Seventy-Five Dollars (\$75.00) per five acre increments over and above the first five acres, which shall provide for inspection by the City inspector, and a plan and design review and study by the City's professional engineers."
- d) The City of Foley Subdivision Regulations, Article IV, Table I subdivision fees as follows:
 - Preliminary Plat fees are \$250.00 + \$30.00 per lot.
 - Final Plat fees are \$150.00 + \$20.00 per lot.
 - Minor Subdivision fees are \$250.00 + \$30.00 per lot
- e) Rezoning by petition of property owner: "A FIVE HUNDRED DOLLAR (\$500.00) fee for 20 acres or less shall be charged to defray the cost of processing application. For every acre over 20 an additional FIFTEEN DOLLARS (\$15.00) per acre fee shall be charged."
- f) The fee for initial zoning shall be TWO HUNDRED FIFTY DOLLARS (\$250.00) and shall be submitted with the petition for annexation and zoning request form attached to the petition.
- g) Board of Adjustment and Appeals Fees: All applications to the Board of Adjustment and Appeals for interpretations, special exceptions, or variances must be accompanied by a check payable to the City of Foley, Alabama, or cash in the amount of \$150.00 which includes the cost of advertising.

SECTION 12: All adopted, valid Flood Damage Prevention Ordinances remain in full force and effect.

SECTION 13. Severability. If any section, subsection, sentence, clause, phrase or portion of this Ordinance is for any reason held invalid or unconstitutional by any court of competent jurisdiction, such portion shall be deemed a separate, distinct and independent provision and such holding shall not affect the validity of the remaining portions thereof.

SECTION 14. Repeal. That this ordinance is intended to update and amend various prior ordinances. Any prior ordinances which are in conflict with this ordinance are hereby repealed and superseded by this ordinance, including, but not limited to, Sections 4-1, 4-2(c) and Section 8-2, Code of the City of Foley.

SECTION 15. That this ordinance shall be published as required by law.

SECTION 16. "The terms and provisions of this ordinance are severable. If any part or portion of this ordinance is declared invalid, void, or unconstitutional, that portion shall be deemed severed, and the remaining portions of the ordinance shall remain in full force and effect."

SECTION 17. All ordinances or parts of ordinances, in any manner conflicting herewith are hereby repealed.

PASSED, ADOPTED AND APPROVED THIS day of , 2017

President's Signature *JW [Signature]* Date 9-6-17

Attest by City Clerk *Kathryn [Signature]* Date 9-6-17

Mayor's Signature *[Signature]* Date 9/6/2017

Exhibit A

COASTAL CONSTRUCTION SUPPLEMENT

S1 Roof Covering

Roof coverings and their attachment must be rated for the ASCE7 design wind speed for the site location of the building and must be installed in accordance with the manufacturer's recommendations for high-wind regions.

Asphalt Shingles:

Table 5: Design Wind Speed and Shingle Testing Standards

Wind Speed	Shingle Testing Standard/ Classification
110 mph	ASTM D3161 (Class F) or ASTM D7158 Class F, G, or H
120 mph	ASTM D7158 Class G or H
130 mph	ASTM D7158 Class H
140 mph	ASTM D7158 Class H
150 mph	

Shingle Attachment:

Shingles shall be installed using the number of fasteners required by the manufacturer for high-wind fastening.

Attachment at eaves, rakes, valleys, gable ends, and starter strips:

Shingles and starter strips at all intersections, eaves, valleys, and gable ends shall be set in a minimum 8-inch wide strip of flashing cement. Maximum thickness of flashing cement shall be 1/8 inch. Shingles shall not extend more than 1/4 inch beyond the drip edge.

Metal Panels:

Metal panel roofing systems and their attachment shall be installed in accordance with the manufacturer's installation instructions and shall provide uplift resistance equal to or greater than the design uplift pressure for the roof based on the site design wind speed and exposure category. The metal panels shall be installed over continuous decking and one of the acceptable sealed roof deck options.

Clay and Concrete Roof Tiles:

Clay and concrete roof tile systems and their attachment shall meet the requirements of the site design wind speed and exposure category. Clay and concrete roof tiles shall be installed in accordance with FRSA/ Tile Roofing Institute installation guidelines, "Concrete and Clay Roof Tile Installation Manual Fourth Edition, FRSA/TRI 07320/08-05" for the site design wind speed and exposure category. Mortar set tile or mortar set hip and ridge tiles (Systems Three and Four B, as listed in FRSA/TRI Manual) are not permitted. Hip and ridge boards shall be attached to the roof framing to resist the uplift pressure for the site design wind speed and exposure or in accordance with Table 11 of the FRSA/Manual. Hip and ridge tiles shall be secured to the hip and ridge boards with mechanical fasteners and/or an approved roof tile adhesive. Note: FRSA/ Tile Roofing Institute installation guidelines, "Concrete and Clay Roof Tile Installation Manual Fourth Edition, FRSA/TRI 07320/08-05" are available for purchase from the Tile Roofing Institute or the Florida Roofing, Sheet Metal and Air Conditioning Contractor's Association.

Other roof coverings:

For all other roof coverings, the designer must provide documentation showing the roof covering and the attachments were designed for the component and cladding wind pressures corresponding to the site design wind speed (up to 150 mph). All roof coverings, regardless of type, must be installed in accordance with the manufacturer's installation guidelines for the appropriate design wind speed.

Residential reroofing:

Reroofing of residential structures shall meet the requirements of this section for roof covering and Section S2 for Sealed Roof Deck. Existing roof coverings shall be removed to expose the roof deck. An inspection is required at this point to determine the adequacy of the roof deck attachment in accordance with the following:

Sawn Lumber or Wood Board Roof Decking:

- Add fasteners as required to ensure that roof decking consisting of sawn lumber or wood boards up to 1 inch thick are secured with at least two nails, having a minimum diameter of 0.131 inches and a minimum length of 2-1/2 inches, (three nails if the board is wider than 8 inches) to each roof framing member it crosses. Framing members must be spaced no more than 24 inches apart. Clipped-head, D-head or round-head nails shall be acceptable provided they have the required minimum diameter and length.
- For wood boards greater than 1 inches thick and up to 2 inches thick, add fasteners as required to ensure that the decking is secured with at least two nails, having a minimum diameter of 0.131 inches and sufficient length to penetrate a minimum of 1-5/8 inches into the roof framing, (three nails if the board is wider than 8 inches) to each framing member it crosses. Framing members must be spaced no more than 24 inches apart. Clipped-head, D-head or round-head nails shall be acceptable provided they have the required minimum diameter and length.

Structural Wood Panel (Plywood or Oriented Strand Board-OSB) Roof Sheathing:

The number and spacing of additional fasteners needed to adequately strengthen the connection of structural wood panel roof sheathing depends on the size, type and spacing of the existing fasteners. With these considerations in mind, the re-nailing solutions

outlined below are based on using ring-shank nails with full round heads as the additional nails. The specific required minimum dimensions and characteristics for the additional ring-shank nails to be used to strengthen the roof deck attachment are:

- full round head diameter (no clipped head nails allowed)
- 2-3/8 inch minimum nail length
- 0.113 inches in diameter

Additional fasteners shall be according to the following Table.

Wind Speed	Existing Fasteners	Existing Spacing	Required Additional Fastening	
			Within 4 foot zone (see Figure 4)	Outside of 4 foot zone
120 mph or less	Staples or 6d nails	Any	6 inches o.c. spacing between additional fasteners along panel edges and intermediate framing	
	8d smooth shank nails	6 inches o.c. or less along panel edges and intermediate framing	No additional fasteners required along panel edges, 6 inches o.c. spacing between additional fasteners along intermediate framing	No additional fasteners required
	8d smooth shank nails	Greater than 6 inches o.c.	6 inches o.c. spacing between existing and additional fasteners along panel edges, 6 inches o.c. spacing between additional fasteners along intermediate framing	6 inches o.c. spacing between existing and additional fasteners along panel edges and along intermediate framing
	8d ring shank nails	12 inches o.c. or less	6 inches o.c. spacing between existing and additional fasteners along panel edges and intermediate framing	6 inches o.c. spacing between existing and additional fasteners along panel edges and along intermediate framing
Greater than 120 mph	Staples or 6d nails	Any	4 inches o.c. spacing between additional fasteners along panel edges and intermediate framing	6 inches o.c. spacing between additional fasteners along panel edges and intermediate framing
	8d smooth shank nails	Less than 6 inches o.c.	4 inches o.c. spacing between existing and additional fasteners along panel edges and 6 inches o.c. between additional fasteners along intermediate framing	No additional fasteners required along panel edges, 6 inches o.c. spacing between additional fasteners along intermediate framing
	8d smooth shank nails	6 inches o.c. or greater	4 inches o.c. spacing between existing and additional fasteners along panel edges and along intermediate framing	6 inches o.c. spacing between existing and additional fasteners along panel edges, 6 inches o.c. spacing between additional fasteners along intermediate framing
	8d ring shank nails	12 inches o.c. or less	4 inches o.c. spacing between existing and additional fasteners along panel edges and along intermediate framing	6 inches o.c. spacing between existing and additional fasteners along panel edges and along intermediate framing

Deteriorated or damaged roof deck:

Damaged or deteriorated decking would generally be marked by one or more of the following characteristics: soft or spongy wood, wood swelling or buckling, delaminating (plywood), or crumbling and flaking of the wood. If deteriorated or damaged roof decking is found, the decking must be replaced and fastened in accordance with this section.

S2 Sealed Roof Deck

A sealed roof deck is required for all new construction and re-roofing applications by one of the following methods:

1. Installation of a "peel and stick" membrane over the entire roof deck;¹
 - o The entire roof deck shall be covered with a full layer of self-adhering polymer modified bitumen membrane ("peel and stick") meeting ASTM D1970 requirements. In applications where membrane adhesion to OSB is marginal, apply a primer to the OSB panels to ensure the proper attachment of the self-adhering membrane to the sheathing.
2. Installation of a minimum 4" wide "peel and stick" tape installed over all the wood roof panel seams, covered by a compliant underlayment over the entire roof;¹
 - o A self-adhering polymer modified bitumen flashing ("peel and stick") tape 4" wide minimum must be applied directly to the roof deck to seal the horizontal and vertical joints in the roof deck.

3. Installation of a high tear strength synthetic underlayment with all vertical and horizontal seams taped;
 - o Application a reinforced synthetic roof underlayment which has an ICC approval as an alternate to ASTM D226 Type II felt paper. The synthetic underlayment must have minimum tear strength of 20 lbs. per ASTM D1970 or ASTM D4533.
 - o This underlayment must be attached using annular ring or deformed shank roofing fasteners with minimum 1 inch diameter caps at 6 inches on center spacing along all laps and at 12" on center in the field or a more stringent fastener schedule if required by the manufacturer for high wind installations. Metal caps are required for areas where the design wind speed is greater than or equal to 140 mph.
 - o The minimum horizontal overlap between rolls is 2-inches and the minimum overlap at the ends of rolls (vertical) is 6-inches.
 - o All seams should be sealed with a compatible adhesive or a compatible 4-inch wide tape except for steep slope roofs with a 12/12 roof pitch (45 degrees) or greater.
 - o Horizontal seams on steep slope roofs with a 12/12 pitch (45 degrees) or greater do not have to be sealed with adhesive or tape provided the overlap for horizontal seams is at least 18 inches.
4. Installation of a closed cell polyurethane spray foam applied to the underside of the roof sheathing at the joints between the sheathing panels and along all intersections between roof sheathing and all roof framing members.
 - o The minimum requirements for the closed cell spray polyurethane foam spray are:
 - Two-component spray polyurethane foam system with a minimum core density of 1.5-3.0 pcf in accordance with ASTM D1622, Standard Test Method for Apparent Density of Rigid Cellular Plastics.
 - Spray polyurethane foam adhesive system should be installed by a properly trained and qualified applicator in accordance with the manufacturer's maintenance and installation guidelines.

S3 Aluminum/Vinyl Soffit

All Aluminum/Vinyl Soffit covering shall be attached to minimum 7/16 OSB or plywood or minimum 2 x 2 wood supports 8 inches OC maximum.

S4 Roof Decking Attachment

Roof decks shall be nailed in accordance with the engineered drawings but no less than 6 inches OC maximum intermediate and edge for zones 1 & 2 and 4 inches OC intermediate and edge for zone 3 using 8d (0.113" x 2-3/8") irregular shank (i.e., ring shank or spiral) nails with full round heads. Staples are not permitted for fastening of the roof decking.

S5 Roof Ventilation

Roof Ventilation shall be designed for the applicable wind load; ridge and off ridge vents shall be tested in accordance with TAS 100(A) for high wind and be labeled for verification of compliance. All roof ventilation shall be anchored in accordance with the manufacturer's installation instructions for the appropriate wind load. Gable vents must be provided with a removable cover that can be attached from the outside made of plywood or a nonporous type of shutter that will prevent water from entering through the gable end vent. Wood structural panels with a minimum thickness of 7/16 inch and a maximum span of 4 feet are permitted as a gable end cover. Panels must be pre-cut so that they can be attached to the framing surrounding the gable vent. Panels shall be pre-drilled as required for the anchorage method and all required hardware shall be provided. Permanent corrosion-

resistant attachment hardware with anchors permanently installed on the building shall be provided. Attachment schedule must be, at a minimum, in accordance with Table 4.

TABLE 4

FASTENER TYPE	FASTENER SPACING (inches) ¹
No. 8 Wood Screw based anchor with 2-inch embedment length ²	16
No. 10 Wood Screw based anchor with 2-inch embedment length ²	16
1/4 Lag screw based anchor with 2-inch embedment length ²	16

Notes for Table 4:

1. Fasteners shall be installed at opposing ends of the wood structural panel and have a 2 inch minimum penetration into the building framing through veneers. Attachment to veneers is not acceptable
2. Where screws are attached to masonry or masonry/stucco, they shall be attached using vibration-resistant anchors having a minimum withdrawal capacity of 1500 lb.

S6 Gable Ends

Unless balloon framed, gable ends over 4 foot high shall be braced with a minimum 2 x 6 horizontal strong back installed at midpoint of the vertical height of the gable end wall. Minimum 2 x 4 diagonal bracing not to exceed 45 degrees or 4 feet OC shall be installed on top of strong back and face nailed with 4-10d nails into side of gable wall framing studs. In addition, when ceiling joists run parallel to the gable end wall, a minimum 2 x 4 x 8 brace shall be installed at maximum 6 feet OC on top of ceiling joists and gable top plate nailed with 2-10d nails at each support. Metal 20 gauge straps shall be installed on top of 2 x 4 lateral brace and over gable top plate into stud below using 10-8d nails top and bottom. Install minimum 2 x 4 bracing under lateral braces adjacent to gable wall.

S7 Continuous Load Path

A continuous load path shall be provided to transfer all lateral and vertical loads from the roof, wall and floor systems to the foundation. All residential structures must have the structural design depicting the load path and all connections signed and sealed by an Alabama registered design professional. Structures may use prescriptive design in accordance with the engineered design limitations of the most current editions of the ANSI/AF&PA Wood Frame Construction Manual (WFCM) or the American Iron and Steel Framing Prescriptive Method for One and Two-family Dwellings (COFS-PM).

S8 Glazed Openings

Glazed openings shall be designed and protected in relation to the applicable wind load.

All glazed opening protection (Impact-rated products and opening protection products) must meet two criteria:

1. **Design pressure rating:** Glazed openings must be rated for the design pressures appropriate for the exposure category, wind speed, window size, and window location on the building and depicted on the building plans. Products must be tested, at a minimum, in accordance with International Residential Code (IRC) accepted standards and installed in accordance with the manufacturer's instructions. Acceptable

International Residential Code (IRC) design pressure test standards for windows and glass doors include AAMA/WDMA/CSA 101/I.S.2/A440, ASTM E330 (products must be tested to 1.5 times design pressure). The Florida Building Code Testing Application Standard, TAS 202 is also acceptable.

- Opening Protection Impact rating:** Plans must indicate the International Residential Code (IRC) accepted test standards for impact resistance including the Large Missile Test of ASTM E 1886 and ASTM E 1996 or AAMA 506. The Florida Building Code Testing Application Standards, TAS 201, 202, and 203 are also acceptable. Labeling for verification of compliance consistent with plan submittal is required at time of inspection

Wood structural panels with a minimum thickness of 7/16 inch and a maximum span of 8 feet are permitted to be used for opening protection. Panels must be pre-cut and pre-drilled as required for the anchorage method and all required hardware shall be provided. Permanent corrosion-resistant attachment hardware with anchors permanently installed on the building must be provided. The attachment schedule must be, at a minimum, in accordance with Table 1.

FASTENER TYPE	FASTENER SPACING (inches)		
	Panel span ≤ 4 feet	Panel span greater than 4' and less than or equal to 6'	Panel span greater than 6' and less than or equal to 8'
No. 8 wood screw based anchor with 2-inch embedment length	16	10	8
No. 10 wood screw based anchor with 2-inch embedment length	16	12	9
¼ inch lag screw based anchor with 2-inch embedment length	16	16	16

S9 Garage Doors

Garage doors shall be rated to or above the applicable wind design load. In addition, garage doors with glazed openings that exceed a total window area of 1–square-foot for a one-car wide garage door or 1.8 square feet for a two-car wide garage door must also be protected from windborne debris.

- For garage doors without glazed openings (windows): Provide a garage door assembly (door and all associated hardware and components) that meets the design wind pressure for the site or protect the garage door with an impact-rated shutter/screen product that meets the design wind pressure for the site. Labeling for verification of compliance is required.
- For garage doors with glazed openings (windows): If the garage door has windows where the total window area on the door is less than or equal to 1.0 square feet for a one car wide garage door or 1.8 square feet for two car wide garage door, then the garage door is only required to meet the design wind pressure requirements for the site. If the garage door has window areas that exceed these total window areas, the door must be rated for the design pressure and the glazing must be rated for both pressure and impact or the garage door shall be protected with an impact rated shutter/screen product that meets the design wind pressure for the site. Labeling for verification of compliance is required.

GARAGE DOOR WIND LOAD GUIDE
 BASED ON ASCE 7-95, EXPOSURE C, HURRICANE-PRONE REGION

Mean Roof Height	Door Size	110 MPH	120 MPH	130 MPH	140 MPH	150 MPH
15 Feet Single Story	Single 9' x 7'	27.4 -30.9	32.6 -36.8	38.2 -43.2	44.3 -50.1	50.9 -57.5
	Double 16' x 7'	26.2 -29.2	31.2 -34.8	36.6 -40.8	42.4 -47.3	48.7 -54.3
25 Feet Double Story	Single 9' x 7'	30.2 -34.2	36.0 -40.7	42.2 -47.8	49.0 -55.4	56.2 -63.6
	Double 16' x 7'	29.0 -32.3	34.5 -38.4	40.5 -45.1	46.9 -52.3	53.9 -60.0

Design pressures above are in Pounds per Square Foot (PSF)

Testing, if required by local authority, may be performed to ASTM E-330, or preferably ANSI/DASMA 108, with acceptance criteria in accordance with ANSI/DASMA 108.

Test conditions:

1. Garage doors shall be tested to both negative and positive pressures. Doors shall be installed simulating normal conditions (i.e., top roller in track radius, other rollers in tracks, all hinges in place, reinforcing hardware in place)
2. Test durations for each test direction shall be as follows:
 - A. 10 seconds at design pressure.
 - B. 10 seconds at 1.5 times the design pressure.

Standard engineering principles may be used to interpolate or extrapolate test results to door sizes not specifically tested. Doors shall include a manufacturer's label certifying compliance to specific load.

This guide is provided for reference purposes only. In all cases the local building authority is the sole and final determiner of the structural and safety requirements, and suitability of the garage door.

Notes:

- Basic Wind Speeds above are three second peak-gust values
- Negative pressures assume door has 2 feet of width in building's end zone.
- Garage doors evaluated as attached to enclosed buildings with a Use Factor of 1.0.
- Doors larger than 100 square feet should use the 16 x 7 loads. Doors less than 100 square feet may be interpolated.
- Garage doors evaluated as Components and Cladding
- Installation details vary. Consult manufacturer's instructions.


S10 Chimney Chases

Wood frame chimney chases shall be structurally connected to rafters and ceiling joists. The attachment must be detailed in the engineered plans or must meet the following minimum requirements:

Each corner of the chimney structure must have a tension strap fastened to the corner stud and continues downward to the roof support members below. The tension strap must have a minimum tension capacity of 700 lbs. at each end.

Chimney framing shall be sheathed with minimum 7/16-inch structural panel on exterior four sides.

The base perimeters of chimney framing must be continuously supported by minimum 2x4 blocking fastened to roof framing members with joist hangers.

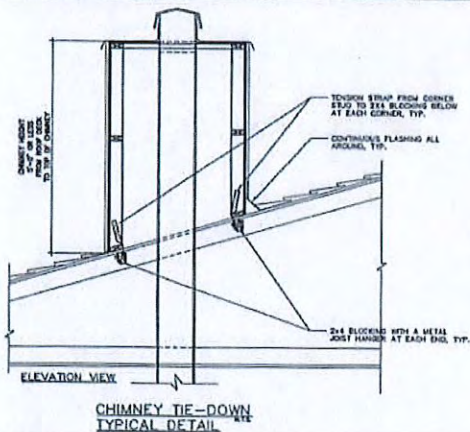

S11 Braced Wall Lines /Shear Walls

Exterior and Interior shear wall and/or braced wall panel locations shall be indicated on the plans and shall be nailed in accordance with the engineered drawings but no less than 6 inches OC maximum intermediate and edge using 8d (0.113" x 2-3/8") irregular shank (i.e., ring shank or spiral) nails with full round heads. Shear wall designs shall meet the engineered design requirements specified in Section S7.



A DIVISION OF OPC NEWS, LLC
PO BOX 1677 • SUMTER, SC 29150

FOLEY 251.943.2151
The Courier – The Islander
The Onlooker
The Baldwin Times

LEGAL REP -
251-345-6805

**PROOF OF PUBLICATION
STATE OF ALABAMA • BALDWIN COUNTY**

Before me, the undersigned authority in and for said County, in said State, personally appeared April M. Wallace who, by me duly sworn, deposes and says that: she is the Legal Representative of the following newspaper listed below, a newspaper of GENERAL CIRCULATION, PUBLISHED and PRINTED in Baldwin County, Alabama, and that there was published in The Courier, The Islander, The Onlooker, & or The Baldwin Times in the issue/s of:

09/13/2017

a legal notice, a copy of which is hereto attached. The sum charged by the Newspaper for said publication does not exceed the lowest classified rate paid by commercial customers for an advertisement of similar size and frequency in the same newspaper(s) in which the public notice appeared.

There are no agreements between the Newspaper and the officer or attorney charged with the duty of placing the attached legal advertising notices whereby any advantage, gain or profit accrued to said officer or attorney.

X April M. Wallace
April M. Wallace, Legal Ad Representative

X Amber Kimbler
Amber Kimbler, Notary Public
Baldwin County, Alabama
My commission expires April 10, 2018



AMBER KIMBLER
My Commission Expires
APRIL 10, 2018

**Ordinance: 17-2037
Building Code & Fee Amendments**
Ordinance 17-2037 was adopted on September 5, 2017 and is available in its entirety for public inspection at the City Clerk's Office located at City Hall 407 E. Laurel Avenue Foley Alabama during normal business hours and on the City's website at: https://library.municode.com/al/foley/codes/code_of_ordinances
/s/ Kathryn Taylor, CMC
City Clerk
September 13, 2017

Sworn and subscribed to on 09/13/2017.

CITY OF FOLEY, LEGAL ACCOUNT

Acct#: 983511

Ad#: 274098

Ordinance: 17-2037

Amount of Ad: \$15.08

Legal File# Ordinance: 17-2

AMENDMENTS TO ORDINANCE #17-2037

RESIDENTIAL DESIGN CRITERIA:

Table R301.2 (1) – Climatic and Geographic Design Criteria – shall be amended as follows:

Table R301.2(1)
CLIMATIC AND GEOGRAPHIC DESIGN CRITERIA

GROUND SNOW LOAD	WIND DESIGN		SEISMIC DESIGN CATEGORY	SUBJECT TO DAMAGE FROM			WINTER DESIGN TEMPERATURE	ICE BARRIER UNDERLAYMENT REQUIRED	FLOOD HAZARDS	AIR FREEZING INDEX	MEAN ANNUAL TEMPERATURE
	Speed (mph)*	Topographic effects		Weathering	Frost Line Depth	Termite					
0	150	NO	A	Negligible	4"	Very Heavy	30	NO	10/7/2008	32	66.7

***Wind design speed is ultimate design wind speed and shall be increased for slope
IAW Table R301.2.1.5.1 of the 2015 International Residential Code**

Section 4. Residential Construction Fees:

New Construction:

- a) Plan Review (Flat Fee): Single Family/Duplex - \$50 per unit, Multi-family – Same as Commercial
- b) Building Permit (Valuation) – See Valuation Fee Method
- c) Electrical Permit (Flat Fee) - ~~\$175 per unit~~
 1-4 units per building - \$175 per unit
 5-16 units per building - \$125 per unit
 More than 16 units per building - \$100 per unit
- d) Plumbing Permit (Flat Fee) - ~~\$100 per unit~~
 1-4 units per building - \$100 per unit
 5-16 units per building - \$90 per unit
 More than 16 units per building - \$80 per unit
- e) Mechanical Permit (Flat Fee) - ~~\$75 per unit~~
 1-4 units per building - \$75 per HVAC unit
 5-16 units per building - \$65 per HVAC unit
 More than 16 units per building - \$55 per HVAC unit

Miscellaneous Residential Fees:

- a) Remodeling/Addition Building Permit (Valuation) See Valuation Fee Method
- b) Remodeling/Addition Electrical Permit (Fixture Count) See Fixture Count Method
- c) Remodeling/Addition Plumbing Permit (Fixture Count) See Fixture Count Method
- d) Remodeling/Addition Mechanical Permit (Flat Fee) - \$75.00 per HVAC unit
- e) Swimming Pool/Spa (Valuation) See Valuation Fee Method
- f) Swimming Pool/Spa Electrical (Fixture Count) See Fixture Count Method
- g) Reroofing (Valuation) See Valuation Fee Method
- h) Electrical Service Panel/Meter Replacement Only (Flat Fee) - \$50.00
- i) Sewer Line Installation/Replacement Only (Flat Fee) - \$50.00

- j) HVAC Unit Replacement Only (Flat Fee) - \$75.00 **per HVAC unit**
- k) **HVAC Duct Work Only – See Mechanical Valuation Method**
- l) Manufactured Home Installation (Flat Fee) - \$50.00
- m) Manufactured Home Installation Electrical (Flat Fee) - \$50.00
- n) Demolition (Flat Fee) - \$50.00 per structure
- o) Contractor Temporary Power Pole Only (Flat Fee) - \$50.00
- p) Fence (Valuation) See Valuation Fee Method
- q) Re-inspection Fee (Flat Fee) - \$25.00 when not prepared for scheduled inspection or for any inspection for the same item after 1st re-inspection
- r) Working Without A Permit Penalty – Permit Fees are doubled plus any additional fees as determined by other City of Foley Departments

Section 5: Commercial Construction Fees:

1. New Construction:
 - a) Plan Review – Fee is equal to one half of the permit fee
 - b) Building Permit (Valuation) – See Valuation Fee Method
 - c) Electrical Permit (Fixture Count) – See Electrical Fixture Count Method
 - d) Plumbing Permit (Fixture Count) – See Plumbing Fixture Count Method
 - e) Mechanical Permit (Valuation) – See Mechanical Valuation Fee Method
2. Miscellaneous Commercial Fees:
 - a) Remodeling/Addition Building Permit (Valuation) See Valuation Fee Method
 - b) Remodeling/Addition Electrical Permit (Fixture Count) See Fixture Count Method
 - c) Remodeling/Addition Plumbing Permit (Fixture Count) See Fixture Count Method
 - d) Remodeling/Addition/ **Duct Work** Mechanical Permit (~~Flat Fee~~) – ~~\$75.00 per unit~~
See Mechanical Valuation Method
 - e) Swimming Pool/Spa (Valuation) See Valuation Fee Method
 - f) Swimming Pool/Spa Electrical (Fixture Count) See Fixture Count Method
 - g) Reroofing (Valuation) See Valuation Fee Method
 - h) Electrical Service Panel/Meter Replacement Only (Flat Fee) - \$50.00
 - i) Sewer Line Installation/Replacement Only (Flat Fee) - \$50.00
 - j) HVAC Unit Replacement Only (Valuation) – See Mechanical Valuation Fee Method
 - k) Manufactured/Modular Office Installation (Valuation) – See Valuation Fee Method
 - l) Manufactured/Modular Office Installation Electrical (Flat Fee) - \$50.00
 - m) Demolition (Flat Fee) - \$100.00 per structure
 - n) New Tenant Power Change-Out Only (Flat Fee) - \$50.00
 - o) Contractor Temporary Power Pole Only (Flat Fee) - \$50.00
 - p) Fence (Valuation) See Valuation Fee Method
 - q) Manufactured/Modular/Mobile Building - Temporary Commercial Use (Flat Fee) - \$225.00 for 6 month period; can be renewed, with approval for the same fee.
 - r) Manufactured/Modular Building - Temporary Construction Field Office (Flat Fee) - \$50.00 for 6 month period; can be renewed, with approval for the same fee.

- s) Manufactured/Modular Building - Temporary Watchman's Quarters (Flat Fee) - \$225.00 for 6 month period; can be renewed, with approval for the same fee.
- t) Tent/Membrane Structure –Temporary Commercial Use (Flat Fee) \$50.00 per period
- u) Re-inspection Fee (Flat Fee) - \$25.00 when not prepared for scheduled inspection or for any inspection for the same item after 1st re-inspection
- v) Working Without A Permit Penalty – Permit Fees are doubled plus any additional fees as determined by other City of Foley Departments
- w) Signs (Valuation) See Valuation Fee Method